

Troubleshooting guide

If you have installed and connected the fitting as per the instructions listed earlier and it does not function correctly, use the following table as a guide to fixing the problem. Look up the type of fault in the left column and check the possible causes from the right column.

If the fitting still does not work after checking these possible causes, contact ABB customer service in Australia on 1800 60 20 20.

No.	Fault	Possible causes
1	LED lamp and indicator LED not lit	AC supply not connected; or AC supply turned off; or Test switch damaged
2	LED lamp not lit but red indicator LED is lit	LED lamp damaged; or LED lamp plug incorrectly inserted in the mother board
3	LED lamp not lit but indicator LED is flashing green	LED lamp damaged; or LED lamp plug incorrectly inserted in the mother board
4	LED lamp is lit but red indicator LED not lit	LED damaged; or Check battery connection
5	The LED lamp does not switch to emergency mode when the test button is pressed	Test switch damaged
6	Indicator LED is constant green	Test switch damaged; or Self check fail - return to factory
7	Indicator LED not red after commissioning	Check battery connection and battery plug polarity
8	The LED lamp works momentarily on emergency when the test button is pressed or tested by command from the Nexus system	Battery not yet charged (allow up to 24 hours)

ABB Australia Pty Limited

For enquiries
ABB contact centre: 1800 60 20 20
E-mail: AU-ABB-Stanilite@abb.com

INSTALLATION MANUAL

Stanilite®

Weatherproof cool-room LED exit (remote body)

Standard, Nexus® LX, Nexus RF



This document covers	What's inside the box
Safety warning	Exit LED weatherproof
Installation instructions	Installation manual
Removal instructions	Warranty information
Testing precautions	
Troubleshooting guide	

Thank you for choosing ABB product

Please read this document thoroughly before commencing installation and retain for future reference. Contact ABB customer service in Australia on 1800 60 20 20 if you need any assistance. The installation instructions were correct at the time of print. To reflect changes in technology and Australian standards; ABB reserves the right to amend the instructions without notice. Updated document can be found on the Stanilite website.

Safety warning

In Australia and New Zealand, only licensed electricians are permitted by law to work with 240 volt electrical installations. Do not attempt to install or connect this product unless you are a licensed electrician. Turn off and isolate the electrical supply before connecting this fitting to the building wires. Do not touch the terminals of the terminal block when the light fitting is energised. The only user-serviceable part is the battery pack. LED light source is not user-serviceable. Do not attempt to service other parts of the fitting as this will void the warranty. As the installer, it is your responsibility to ensure compliance with all relevant building and safety codes, (ie: AS/NZS 3000, AS/NZS 2293). Refer to the applicable standards for data and mains

cabling installation procedures and requirements.

Important to note:

- This product is designed for indoor and outdoor use.
- Not suitable for installations where exposure to direct sunlight may occur.



No mains or mains carrying cables are to be connected to the terminals in the cool-room LED exit remote body.

The output from the remote power supply only to be connected to the LED exit remote body.

Installation instructions

Important: The mounting holes are at the same location as the lid's screws, see figure 2. The holes centre distance is 164 x 354mm. If the mounting holes are drilled through the enclosure, the installer must seal the holes with suitable sealant to maintain the enclosure IP rating integrity.

1. Unscrew 4 screws and remove the lid.
2. Unscrew 4 screws from the gear tray then remove it from the enclosure.
3. Decide on the mains entry (back or side) then drill a cable entry hole to suit the conduit or cable gland size. Remove all burrs and sharp edges around the cable entry hole and make sure the enclosure is free of dust. For cable side entry; the holes centre is 25mm from the base.

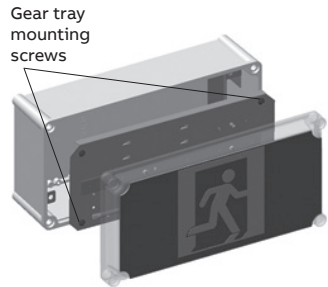


Figure 1

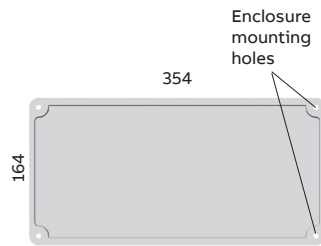


Figure 2

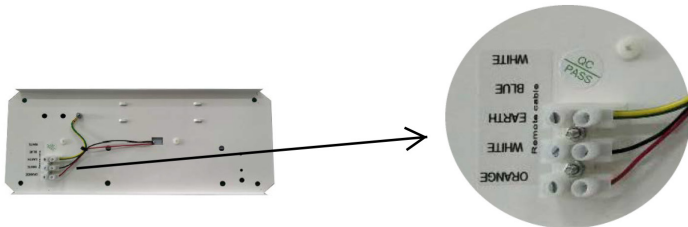


Figure 3

4. Determine the mounting location, hold the enclosure in position and secure it in place by appropriate M6 screws (the housing mounting holes diameter is 6.4mm) (due to the wide variety of building construction materials, fasteners are not supplied). Make sure the mounting screws are fixed into solid material that is strong enough to support the weight of the fitting which is approximately 4kg. A suitable washer should be used in conjunction with the screw.
5. Run cable in the ceiling or wall space as appropriate or surface mounted in conduit, slide the cable gland over the cable then feed the cable through the entry hole of the enclosure. Allow adequate wire length to reach the terminal block then secure the cable gland in place.
6. Terminate wires to the terminal block. Be careful with multi-strand conductors that all the strands are twisted together before insertion into the terminal block. Any stray strands that inadvertently come into contact with their neighbouring terminal will cause undesirable results when fitting is powered.

Wire colour

Orange +ive	Red wire to LED strip
White -ive	Black wire to LED strip
Earth	Green/Yellow to terminal Earth or 

7. Install the gear tray and secure it to the enclosure by 4 screws.
8. Check operation of the fitting to ensure that the installation was successful. When powered up, allow a few minutes to give the battery a small charge then press the test button. Hold the test button in for a few seconds and observe the operation of the lamp switching from mains to the emergency mode. If the lamp on emergency mode works momentarily, that's okay. Try again in a few more minutes in case battery is completely discharged, it may take a little time to charge up enough to operate even momentarily. After this time, press the test button again and if the lamp does not work at all, check the supply, the connections and follow the instruction given in the troubleshooting guide at the end of this document.

Important: 24 hours is required to allow the fitting battery to reach full capacity, ie: prior to a discharge test. As the installer, it is your responsibility to conduct the initial discharge testing of the installed fitting. Refer to AS/NZS 2293.

Removal instructions

1. Before removing the installed fitting, de-energise and lock off the supply circuit.
Note: There may be 2 actives present, ensure all power is isolated before proceeding.
2. Remove the lid and gear tray from the enclosure.
3. Disconnect the mains supply from the terminal block (and data cable for Nexus LX fitting or antenna cable for Nexus RF fitting) and disconnect the battery plug from the PCA before removing the fitting.

Testing precautions

Once the fitting is permanently connected to the mains supply, a commissioning discharge test as required in AS/NZS 2293.2 must be carried out. You will need to allow 24 hours for the battery to fully charge prior to conducting this test, presently (at the time of writing), the standard requires that fittings operate in emergency mode for a period not less than 2 hours for their commissioning test and for not less than 90 minutes thereafter (it is required that 6 monthly discharge tests be carried out). You will need to keep the records for the commissioning test and enter them into the building emergency services logbook or via other recording methods as allowed by AS/NZS 2293.2.

Construction sites

Continuously switching off the mains power supply that is connected to emergency light fittings during the construction phase of an installation will cause these fittings to discharge and charge their batteries many times over a short period; this can shorten life of the battery. ABB does not recommend such practices and may not honour the warranty on batteries when they are subjected to such harsh operating conditions. Emergency light fittings are designed to be discharge tested once every 6 months as per AS/NZS 2293.2, subjecting the product to repeated discharge or charge cycles is regarded as an abuse of the fittings.